


NOTES:

1. DIRECT BURY RATED WIRE ONLY
2. CONDUIT OPTIONAL



ITEM	TO BE SUPPLIED AND INSTALLED BY CONTRACTOR/HOMEOWNER:
A	6X6 TREATED POST OR BACK BOARD
B	APPLICABLE AMP RATED LEVER BYPASS METER SOCKET
C	APPLICABLE AMP RATED SERVICE DISCONNECT WITH OVERCURRENT PROTECTION.
D	GROUNDING IN ACCORDANCE WITH NEC REQUIREMENTS
E	GRAVEL BACKFILL
F	SOURCE AND LOAD SIDE WIRE IN ACCORDANCE WITH NEC REQUIREMENTS

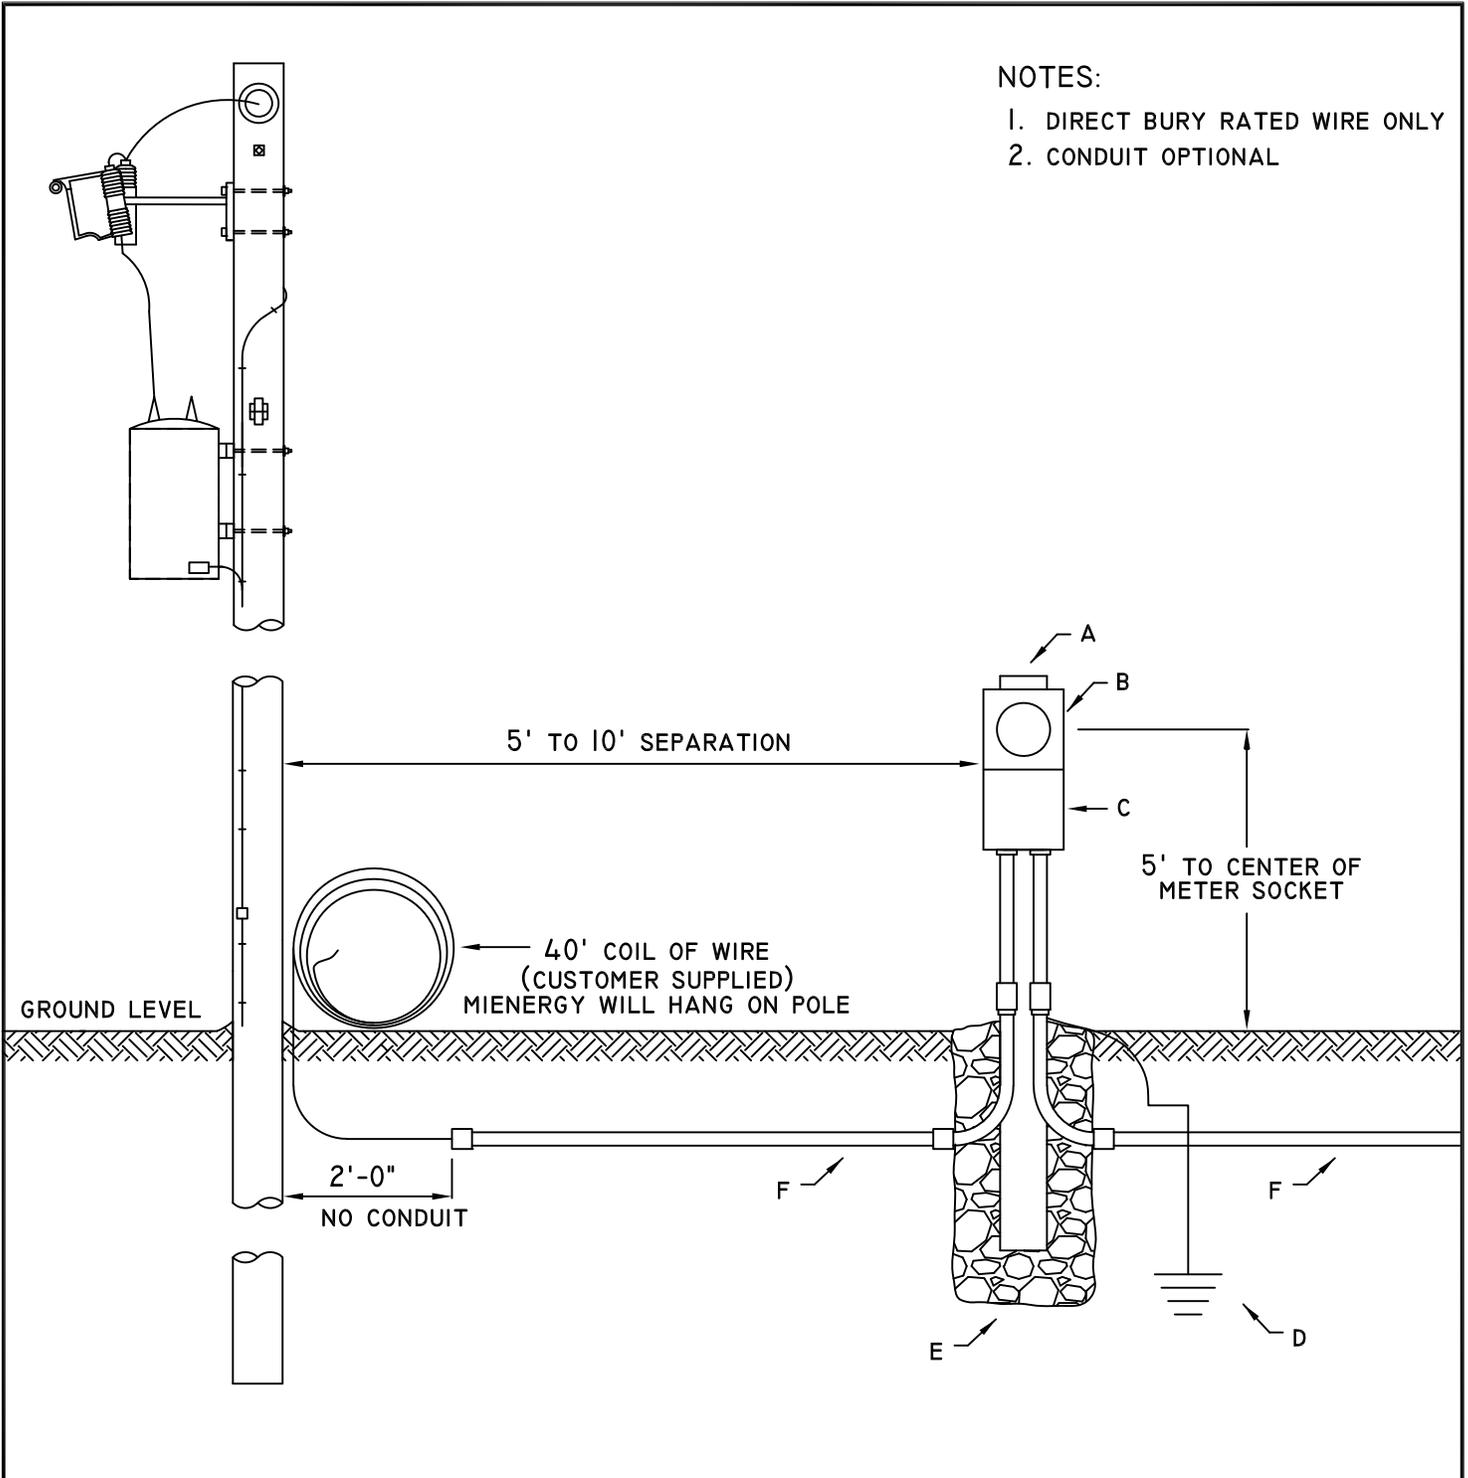

STANDARD FOR UNDERGROUND SERVICE
FROM OVERHEAD TRANSFORMER POLE
100AMP, 200AMP OR 320AMP

FEBRUARY 2026

BY: JDG

REV: CEC

UGS-I