


NOTES:

1. DIRECT BURY RATED WIRE ONLY
2. CONDUIT OPTIONAL
3. SEE ASSOCIATED DRAWING WPMS-I
OR ASSOCIATED DRAWING SPMS-I

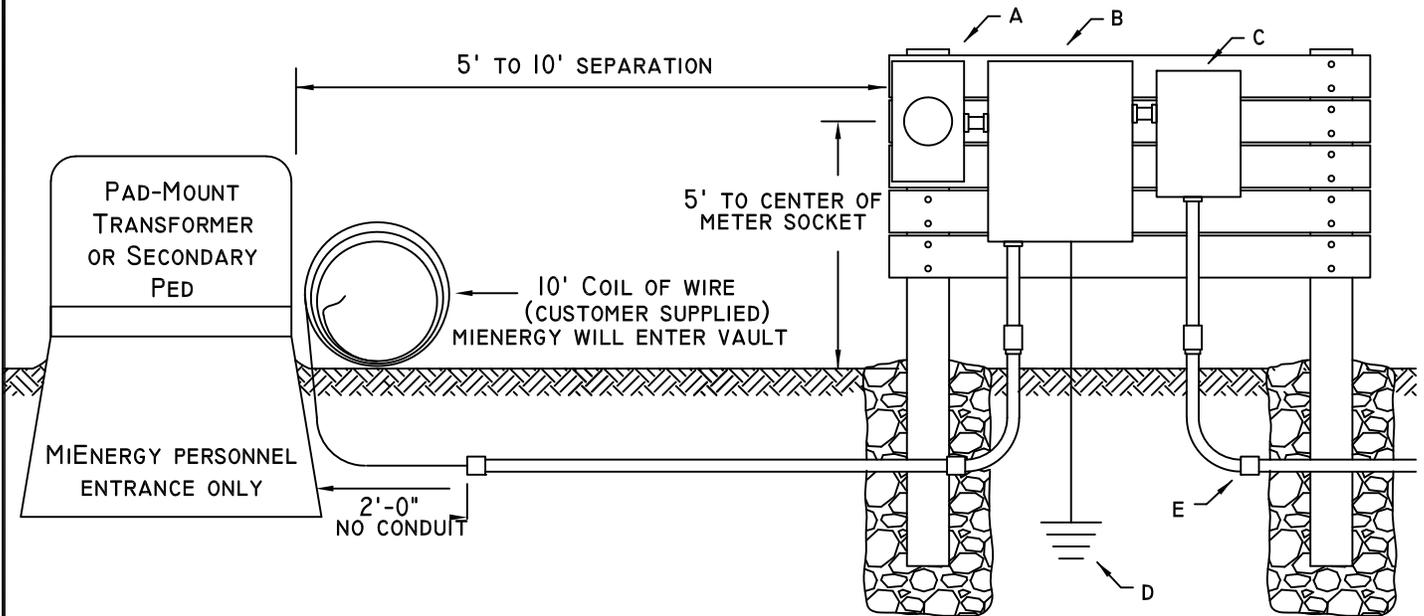

ITEM	TO BE SUPPLIED AND INSTALLED BY CONTRACTOR/HOMEOWNER:
A	APPLICABLE METER SOCKET
B	APPLICABLE AMP RATED CT CABINET
C	APPLICABLE AMP RATED OVER CURRENT DISCONNECT
D	GROUNDING IN ACCORDANCE WITH NEC REQUIREMENTS
E	SOURCE AND LOAD SIDE WIRE IN ACCORDANCE WITH NEC REQUIREMENTS

	STANDARD FOR UNDERGROUND SERVICE FROM UNDERGROUND TRANSFORMER 400AMP OR GREATER		
	FEBRUARY 2026	BY: JDG	REV: CEC